GLASSVENT® UT WINDOW Architectural Detail Manual February 2024 ADME077EN KAWNEER




Table of Contents

Introduction	
Contacting Kawneer	7
Conventions Used in this Document	8
Product Overview	9
Features	9
Project-Out Window	10
Project-Out Window - 1" Infill	
CW (Shallow) - Project-Out Window - 1" Infill	
AW (Deep) - Project-Out Window - 1" Infill	
Project-Out Window - 1-3/4" Infill	
CW (Shallow) - Project-Out Window - 1-3/4" Infill	
AW (Deep) - Project-Out Window - 1-3/4" Infill	
Accessories - Project-Out Window	16
Outswing Casement Window	17
Outswing Casement Window - 1" Infill	
CW (Shallow) - Outswing Casement Window - 1" Infill	
AW (Deep) - Outswing Casement Window - 1" Infill	
Outswing Casement Window - 1-3/4" Infill	20
CW (Shallow) - Outswing Casement Window - 1-3/4" Infill	
AW (Deep) - Outswing Casement Window - 1-3/4" Infill	
Accessories - Outswing Casement Window	23
Thermal Performance	24
Example of Generic Project-Specific U-Factor Calculation	
Glass Area Chart	
AW (Deep) - Project-Out Window with 1" Glazing (Warm-Edge Glazing Spacer)	
System U-factor for Glass Area	
AW (Deep) - Project-Out Window with 1" Glazing	27
System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Project-Out Window with 1" Glazing	28
System Visible Transmittance (VT) - AW (Deep) - Project-Out Window with 1" Glazing	
AW (Deep) - Project-Out Window with 1-3/4" Glazing (Warm-Edge Glazing Spacer)	
System U-factor for Glass Area	
AW (Deep) - Project-Out Window with 1-3/4" Glazing	31
System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Project-Out Window with 1-3/4" Glazing	32
System Visible Transmittance (VT) - AW (Deep) - Project-Out Window with 1-3/4" Glazing	33
AW (Deep) - Outswing Casement Window with 1" Glazing (Warm-Edge Glazing Spacer)	
System U-factor for Glass Area	34
AW (Deep) - Outswing Casement Window with 1" Glazing	35
System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Outswing Casement	
Window with 1" Glazing	36




System Visible Transmittance (VT) - AW (Deep) - Outswing Casement Window with 1" Glazing	. 37
AW (Deep) - Outswing Casement Window with 1-3/4" Glazing (Warm-Edge Glazing Spacer)	
System U-factor for Glass Area	
AW (Deep) - Outswing Casement Window with 1-3/4" Glazing	
System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Outswing Casement	
Window with 1-3/4" Glazing	40
System Visible Transmittance (VT) - AW (Deep) - Outswing Casement Window with	
1-3/4" Glazing	41
AW (Deep) - Project-Out Window with 1" Glazing (Aluminum Glazing Spacer)	42
System U-factor for Glass Area	42
AW (Deep) - Project-Out Window with 1" Glazing	43
System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Project-Out Window with 1"	
Glazing	44
System Visible Transmittance (VT) - AW (Deep) - Project-Out Window with 1" Glazing	45
AW (Deep) - Project-Out Window with 1-3/4" Glazing (Aluminum Glazing Spacer)	46
System U-factor for Glass Area	
AW (Deep) - Project-Out Window with 1-3/4" Glazing	47
System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Project-Out Window with	
1-3/4" Glazing	48
System Visible Transmittance (VT) - AW (Deep) - Project-Out Window with 1-3/4"	
Glazing	49
AW (Deep) - Outswing Casement Window with 1" Glazing (Aluminum Glazing Spacer)	
System U-factor for Glass Area	
AW (Deep) - Outswing Casement Window with 1" Glazing	51
System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Outswing Casement	
Window with 1" Glazing	. 52
System Visible Transmittance (VT) - AW (Deep) - Outswing Casement Window with 1"	
Glazing	. 53
AW (Deep) - Outswing Casement Window with 1-3/4" Glazing (Aluminum Glazing Spacer)	
System U-factor for Glass Area	
` ','	. ၁၁
System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Outswing Casement Window with 1-3/4" Glazing	56
System Visible Transmittance (VT) - AW (Deep) - Outswing Casement Window with	50
1-3/4" Glazing	57
CW (Shallow) - Project-Out Window with 1" Glazing (Aluminum Glazing Spacer)	
System U-factor for Glass Area	
CW (Shallow) - Project-Out Window with 1" Glazing	
System Solar Heat Gain Coefficient (SHGC) - CW (Shallow) - Project-Out Window with	00
1" Glazing	60
System Visible Transmittance (VT) - CW (Shallow) - Project-Out Window with 1"	00
Glazing	61
CW (Shallow) - Project-Out Window with 1-3/4" Glazing (Aluminum Glazing Spacer)	
System U-factor for Glass Area	
CW (Shallow) - Project-Out Window with 1-3/4" Glazing	
System Solar Heat Gain Coefficient (SHGC) - CW (Shallow) - Project-Out Window with	=
1-3/4" Glazing	64



System Visible Transmittance (VT) - CW (Shallow) - Project-Out Window with 1-3/4"	
Glazing	65
CW (Shallow) - Outswing Casement Window with 1" Glazing (Aluminum Glazing Spacer)	66
System U-factor for Glass Area	66
CW (Shallow) - Outswing Casement Window with 1" Glazing	67
System Solar Heat Gain Coefficient (SHGC) - CW (Shallow) - Outswing Casement	
Window with 1" Glazing	68
System Visible Transmittance (VT) - CW (Shallow) - Outswing Casement Window with	
1" Glazing	69
CW (Shallow) - Outswing Casement Window with 1-3/4" Glazing (Aluminum Glazing	
Spacer)	
System U-factor for Glass Area	70
CW (Shallow) - Outswing Casement Window with 1-3/4" Glazing	71
System Solar Heat Gain Coefficient (SHGC) - CW (Shallow) - Outswing Casement	
Window with 1-3/4" Glazing	72
System Visible Transmittance (VT) - CW (Shallow) - Outswing Casement Window with	
1-3/4" Glazing	73
tes and Disclaimers	74





Introduction

Contacting Kawneer

For contact information, visit www.Kawneer.com.



Conventions Used In This Document

These symbols identify special types of information that can help you use the document more effectively.

	Symbol	Description
	NOTE	Denotes general information that provides additional context or guidance
0	IMPORTANT	Denotes information to which you should pay special attention
©	TIP	Denotes information that can help you perform a task more efficiently

Metric (SI) Conversion. Metric (SI) conversion figures are included throughout this document for reference. Numbers in parentheses () are millimeters unless otherwise noted. The following metric (SI) units may also appear: m – meter; cm – centimeter; mm – millimeter; s – second; Pa – pascal; MPa – megapascal.



Product Overview



NOTE

Additional information and CAD details are available at www.Kawneer.com.

Features

For specific product applications, consult your Kawneer representative.


- Commercial Grade Window (CW) and Architectural Grade Window (AW)
- · Tested to US and Canadian Standards
- · 45° Mitered Vent and Frame Corners
- Staked Corner Joinery
- · Architectural Anodized Finishes and Applied Coatings
- · Large Missile and Small Missile Hurricane Impact Tested AW (Deep) only
- · Blast Mitigation Tested AW (Deep) only



9

Project-Out Window

Project-Out Window - 1" Infill

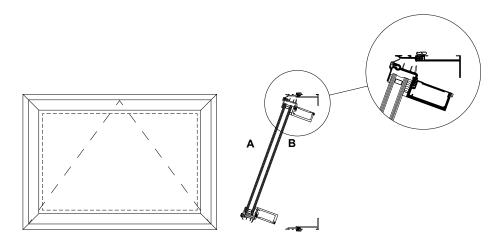


- Exterior
- Interior


CLASS and GRADE	CLASS CW-PG70-AP / AW-PG90-AP		
TESTING STANDARD	AAMA / WDMA / CSA / 101 / I.S.2 / A440 (NAFS)		
SYSTEM DEPTH	CW (Shallow) - 3-1/8" / AW (Deep) - 4-3/8" Overall System Depth		
TYPICAL WALL THICKNESS	CW (Shallow)125 Nominal Frame / .100" Nominal Vent		
	AW (Deep) 125 Nominal Frame / .156" Nominal Vent		
TYPICAL MAX. VENT SIZE	CW (Shallow) - 48" x 32" / AW (Deep) - 60" x 36"		
TYPICAL MIN. VENT SIZE	17" x 17"		
INFILL OPTIONS	1"		
STANDARD HARDWARE	Stainless Steel 4-Bar Hinges		
	Cast White Bronze Cam Handles		
OPTIONAL HARDWARE	Access Control Locks		
	Hook Bolt Lock Handle		
	Pivot Shoe Roto-Operator (Size Limitations - Minimum 26" Wide x 17" High, Maximum 60" Wide x 36" High) (Verify with application engineering project specific limit stop requirements based on window size)		
	Limit Stop (Verify with application engineering project specific limit stop requirements based on window size)		
	Pole and Pole Ring		
	Omni Drive (5 lb) operating force.		
	AW (Deep version 1" infill)		
	(Consult Application Engineering on project specific application)		
OTHER OPTIONS	Insect Screens		




CW (Shallow) - Project-Out Window - 1" Infill

Typical Elevation 1 2



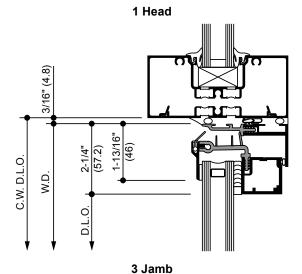



- A. Structural Silicone Sealant (by Others)*
- B. Trim Cap available in #29 Black anodized finish only.



NOTICE

* Installer is responsible for all required compatibility review and approvals with the Structural Silicone Manufacturer and the Insulating Glass Unit Manufacturer.




NOTE

The Kawneer GLASSvent® UT Window is shown with Trifab® 451UT Framing System for reference. Other Kawneer systems can be used. For product specific applications, consult your Kawneer representative.



AW (Deep) - Project-Out Window - 1" Infill

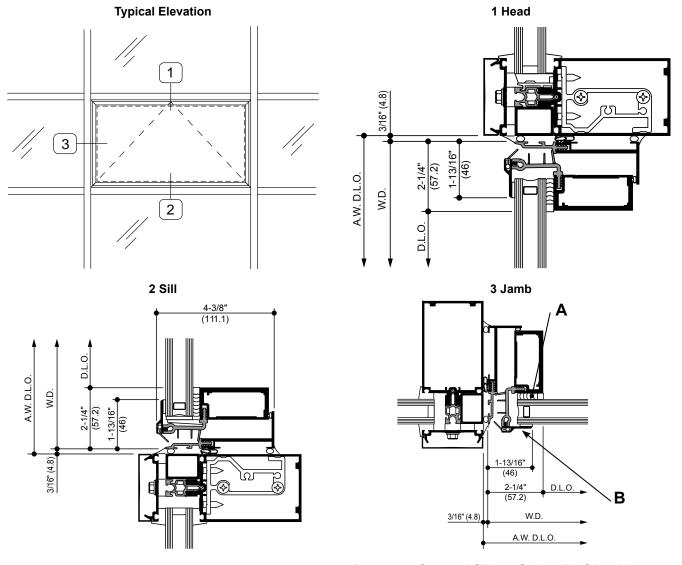

- A. Structural Silicone Sealant (by Others)*
- B. Trim Cap available in #29 Black anodized finish only.



NOTICE

* Installer is responsible for all required compatibility review and approvals with the Structural Silicone Manufacturer and the Insulating Glass Unit Manufacturer.




NOTE

The Kawneer GLASSvent® UT Window is shown with 1600UT Framing System®1 Curtain Wall for reference. Other Kawneer systems can be used. For product specific applications, consult your Kawneer representative.



Project-Out Window - 1-3/4" Infill

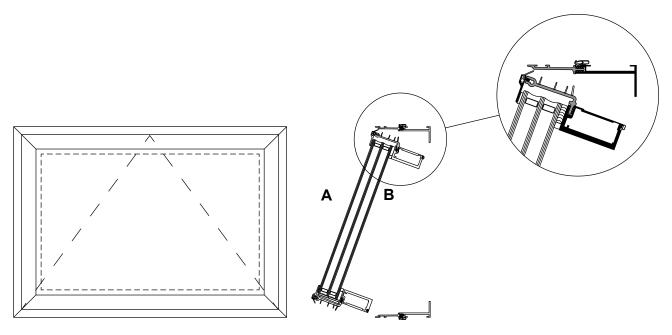


- A. Exterior
- B. Interior

CLASS and GRADE	CLASS CW-PG70-AP / AW-PG90-AP
TESTING STANDARD	AAMA / WDMA / CSA / 101 / I.S.2 / A440 (NAFS)
SYSTEM DEPTH	CW (Shallow) - 3-7/8" / AW (Deep) - 5-1/8" Overall System Depth
TYPICAL WALL THICKNESS	CW (Shallow)125 Nominal Frame / .100" Nominal Vent
	AW (Deep) 125 Nominal Frame / .156" Nominal Vent
TYPICAL MAX. VENT SIZE	CW (Shallow) - 48" x 32" / AW (Deep) - 60" x 36"
TYPICAL MIN. VENT SIZE	17" x 17"
INFILL OPTIONS	1-3/4"
STANDARD HARDWARE	Stainless Steel 4-Bar Hinges
	Cast White Bronze Cam Handles
OPTIONAL HARDWARE	Access Control Locks
	Hook Bolt Lock Handle
	Pivot Shoe Roto-Operator (Size Limitations - Minimum 26" Wide x 17" High, Maximum 60" Wide x 36" High) (Verify with application engineering project specific limit stop requirements based on window size)
	Limit Stop (Verify with application engineering project specific limit stop requirements based on window size)
	Pole and Pole Ring
OTHER OPTIONS	Insect Screens



CW (Shallow) - Project-Out Window - 1-3/4" Infill

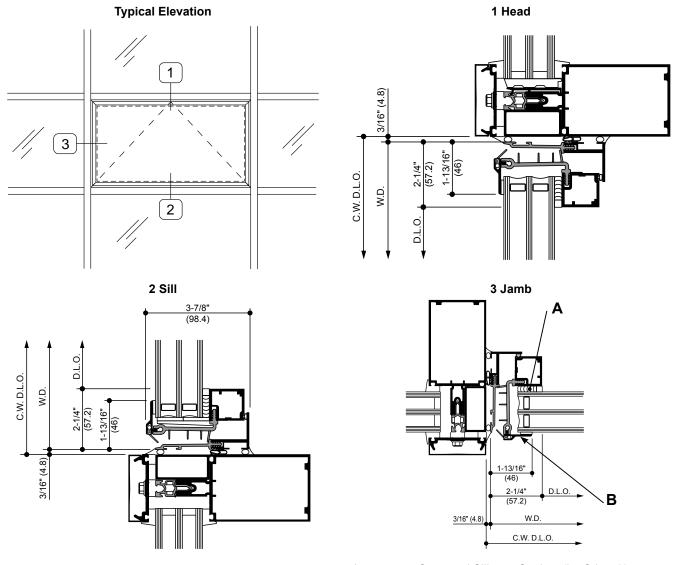

- A. Structural Silicone Sealant (by Others)*
- B. Trim Cap available in #29 Black anodized finish only.



NOTICE

* Installer is responsible for all required compatibility review and approvals with the Structural Silicone Manufacturer and the Insulating Glass Unit Manufacturer.



NOTE

The Kawneer GLASSvent® UT Window is shown with 1600UT Framing System®1 Curtain Wall for reference. Other Kawneer systems can be used. For product specific applications, consult your Kawneer representative.



AW (Deep) - Project-Out Window - 1-3/4" Infill

Typical Elevation 1 Head 3/16" (4.8) 3 1-13/16" 2-1/4" (57.2)(46)A.W. D.L.O. W.D. 2 Ö D.L. 2 Sill 3 Jamb 5-1/8" (130.2)A.W. D.L.O. 1-13/16" (46) 3/16" (4.8) 1-13/16" (46) D.L.O. 2-1/4" В

A. Structural Silicone Sealant (by Others)*

3/16" (4.8)

B. Trim Cap available in #29 Black anodized finish only.

W.D.

A.W. D.L.O.



NOTICE

* Installer is responsible for all required compatibility review and approvals with the Structural Silicone Manufacturer and the Insulating Glass Unit Manufacturer.




NOTE

The Kawneer GLASSvent® UT Window is shown with 1600UT Framing System®1 Curtain Wall for reference. Other Kawneer systems can be used. For product specific applications, consult your Kawneer representative.



Accessories - Project-Out Window

STAINLESS STEEL 4 BAR HINGES



A standard hinge for ventilators providing approximately 45° to 60° openings depending on size. An optional limit stop is available to restrict hinge travel and limit vent opening.

CAM HANDLE



Cast white bronze cam handles are standard for the manual operation and locking of ventilators.

CAM HANDLE WITH POLE RING




Cast white bronze cam handles with pole ring provide manual operation of ventilators located above reach. These handles are operated with a sash pole.

POLE RING



Cast white bronze pole ring is used in conjunction with locking hardware for sash pole operation of ventilators.

SASH POLE AND HANGER



A 3/4" diameter aluminum sash pole with a cast white bronze pull down hook and black rubber tip. Available in 6 ft. and 12 ft. lengths with optional cast white bronze Pole Hanger.

ACCESS CONTROL LOCK



In lieu of cam handles cast white bronze access control locks are offered for managed control of vent operations. Lock is operated with a manganese bronze removable handle.

PIVOT-SHOE ROTO-OPERATOR



Optional pivot shoe roto operator is located on the center line of the bottom horizontal frame. Standard finish shall be gray.

HOOK BOLT LOCK



For use with pivot-shoe roto operator in lieu of cam handles. Standard finish shall be US-25-D clear white bronze.

OMNI DRIVE HANDLE




Omni Drive hardware to support 5 lb operating force lock handle. Powder coat: black or white.



Outswing Casement Window

Outswing Casement Window - 1" Infill




- A. Hinged Left
- B. Interior
- C. Exterior


CLASS and GRADE	CLASS CW-PG70-C / AW-PG90-C
TESTING STANDARD	AAMA / WDMA / CSA / 101 / I.S.2 / A440 (NAFS)
SYSTEM DEPTH	CW (Shallow) - 3-1/8" / AW (Deep) - 4-3/8" Overall System Depth
TYPICAL WALL THICKNESS	CW (Shallow)125 Nominal Frame / .100" Nominal Vent
	AW (Deep) 125 Nominal Frame / .156" Nominal Vent
TYPICAL MAX. VENT SIZE	CW (Shallow) - 32" x 48" / AW (Deep) - 36" x 60"
TYPICAL MIN. VENT SIZE	17" x 24"
INFILL OPTIONS	1"
STANDARD HARDWARE	Stainless Steel 4-Bar Hinges
	Cast White Bronze Cam Handles
OPTIONAL HARDWARE	Access Control Locks
	Hook Bolt Lock of Multi-Point Lock
	Roto Operator (Size Limitations - Minimum 25" Wide x 24" High, Maximum 36" Wide x 60" High) (Verify with application engineering project specific limit stop requirements based on window size)
	Limit Stop (Verify with application engineering project specific limit stop requirements based on window size)
	Pole and Pole Ring
OTHER OPTIONS	Insect Screens




CW (Shallow) - Outswing Casement Window - 1" Infill

Typical Elevation 1 2







- A. Structural Silicone Sealant (by Others)*
- B. Trim Cap available in #29 Black anodized finish only.



NOTICE

* Installer is responsible for all required compatibility review and approvals with the Structural Silicone Manufacturer and the Insulating Glass Unit Manufacturer.





NOTE


The Kawneer GLASSvent® UT Window is shown with Trifab® 451UT Framing System for reference. Other Kawneer systems can be used. For product specific applications, consult your Kawneer representative.




AW (Deep) - Outswing Casement Window - 1" Infill





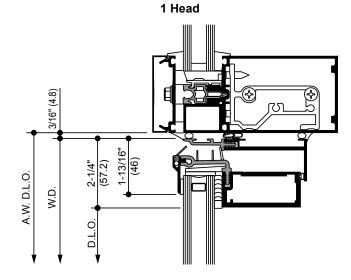



- A. Structural Silicone Sealant (by Others)*
- B. Trim Cap available in #29 Black anodized finish only.



NOTICE

* Installer is responsible for all required compatibility review and approvals with the Structural Silicone Manufacturer and the Insulating Glass Unit Manufacturer.




NOTE

The Kawneer GLASSvent® UT Window is shown with 1600UT Framing System®1 Curtain Wall for reference. Other Kawneer systems can be used. For product specific applications, consult your Kawneer representative.



Outswing Casement Window - 1-3/4" Infill

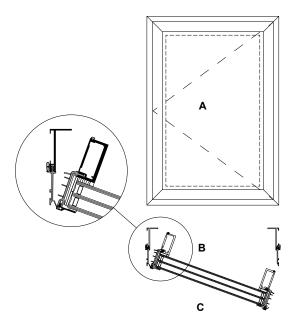


- A. Hinged Left
- B. Interior
- C. Exterior


CLASS and GRADE	CLASS CW-PG70-C / AW-PG90-C
TESTING STANDARD	AAMA / WDMA / CSA / 101 / I.S.2 / A440 (NAFS)
SYSTEM DEPTH	CW (Shallow) - 3-7/8" / AW (Deep) - 5-1/8" Overall System Depth
TYPICAL WALL THICKNESS	CW (Shallow)125 Nominal Frame / .100" Nominal Vent
	AW (Deep) 125 Nominal Frame / .156" Nominal Vent
TYPICAL MAX. VENT SIZE	CW (Shallow) - 32" x 48" / AW (Deep) - 36" x 60"
TYPICAL MIN. VENT SIZE	17" x 24"
INFILL OPTIONS	1-3/4"
STANDARD HARDWARE	Stainless Steel 4-Bar Hinges
	Cast White Bronze Cam Handles
OPTIONAL HARDWARE	Access Control Locks
	Hook Bolt Lock or Multi-Point Lock
	Limit Stop (Verify with application engineering project specific limit stop requirements based on window size)
	Pole and Pole Ring
	Roto Operator (Size Limitations - Minimum 25" Wide x 24" High, Maximum 36" Wide x 60" High) (Verify with application engineering project specific limit stop requirements based on window size)
OTHER OPTIONS	Insect Screens




CW (Shallow) - Outswing Casement Window - 1-3/4" Infill

Typical Elevation 1 2

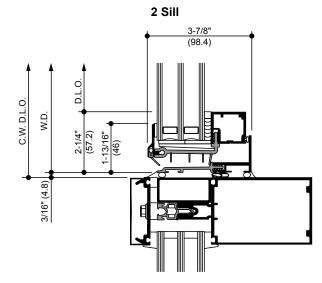

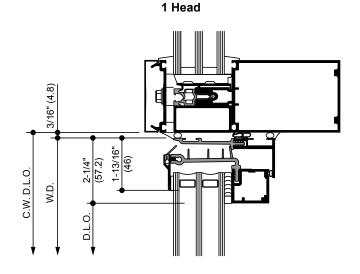



- A. Structural Silicone Sealant (by Others)*
- B. Trim Cap available in #29 Black anodized finish only.



NOTICE

* Installer is responsible for all required compatibility review and approvals with the Structural Silicone Manufacturer and the Insulating Glass Unit Manufacturer.




NOTE

The Kawneer GLASSvent® UT Window is shown with 1600UT Framing System®1 Curtain Wall for reference. Other Kawneer systems can be used. For product specific applications, consult your Kawneer representative.



AW (Deep) - Outswing Casement Window - 1-3/4" Infill

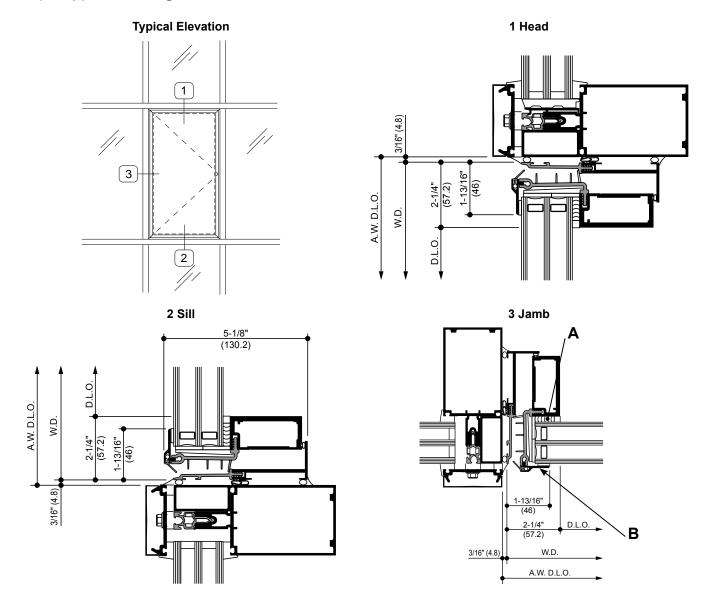

- A. Structural Silicone Sealant (by Others)*
- B. Trim Cap available in #29 Black anodized finish only.



NOTICE

* Installer is responsible for all required compatibility review and approvals with the Structural Silicone Manufacturer and the Insulating Glass Unit Manufacturer.



NOTE

The Kawneer GLASSvent® UT Window is shown with 1600UT Framing System®1 Curtain Wall for reference. Other Kawneer systems can be used. For product specific applications, consult your Kawneer representative.



Accessories - Outswing Casement Window

STAINLESS STEEL 4 BAR HINGES



A standard hinge for ventilators providing an opening of up to 45°. An optional limit stop is available to restrict hinge travel and limit vent opening.

CAM HANDLE



Cast white bronze cam handles are standard for the manual operation and locking of ventilators.

CAM HANDLE WITH POLE RING



Cast white bronze cam handles with pole ring provide manual operation of ventilators located above reach. These handles are operated with a sash pole.

POLE RING



Cast white bronze pole ring is used in conjunction with locking hardware for sash pole operation of ventilators.

SASH POLE AND HANGER



A 3/4" diameter aluminum sash pole with a cast white bronze pull down hook and black rubber tip. Available in 6 ft. and 12 ft. lengths with optional cast white bronze Pole Hanger.

ACCESS CONTROL LOCK



In lieu of cam handles cast white bronze access control locks are offered for managed control of vent operations. Lock is operated with a manganese bronze removable handle.

ROTO-OPERATOR



Roto operators are used with butt hinges only and located at the bottom horizontal frame. Standard finish shall be brushed copper nickel to match US-25-D.

HOOK BOLT LOCK



Optional hook bolt lock in lieu of cam handle. Standard finish shall be US-25-D clear white bronze.

MULTI-POINT LOCK



Optional single locking handle for concealed multipoint locks located on the vertical frame. Standard finish shall be US-25-D clear white bronze.




Thermal Performance

Example of Generic Project-Specific U-Factor Calculation



NOTE

The percent of glass will vary on specific products, depending on sightlines.



Example Glass U-factor = 0.28 Btu/(ft² • h • °F)

Total Daylight Opening = 31-1/2" • 55-1/2" = 12.14 ft^2

Total Projected Area = $3'0" \cdot 5' \cdot 0" = 15 \text{ ft}^2$

Percentage of Glass = (Total Daylight Opening ÷ Total Projected Area) • 100


 $= (12.14 \div 15) \cdot 100 = 81\%$

Glass Area Chart

Based on 81% glass and center-of-glass U-factor of 0.28, the system U-factor is equal to 0.38 Btu/(h \cdot ft² \cdot °F).



System U-factor vs Percent of Glass Area

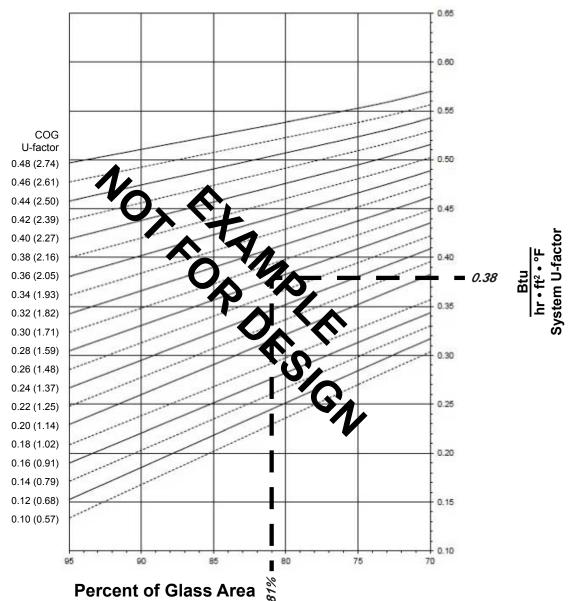

AW (Deep) - Project-Out Window with 1" Glazing (Warm-Edge Glazing Spacer)



NOTE


These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.



System U-factor for Glass Area



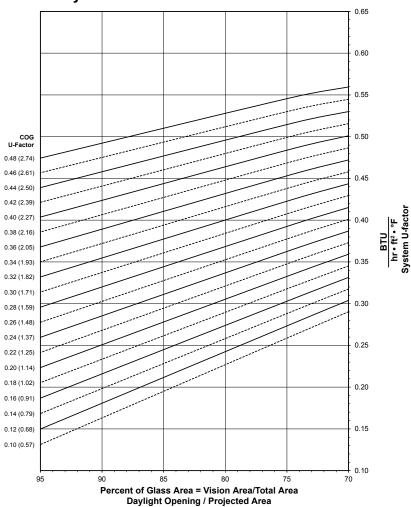

See Note, page 25.



AW (Deep) - Project-Out Window with 1" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

memiai manamitai	
Glass U-factor a. b. c.	Overall U-factor d.
0.48	0.55
0.46	0.53
0.44	0.52
0.42	0.50
0.40	0.49
0.38	0.47
0.36	0.46
0.34	0.44
0.32	0.43
0.30	0.41
0.28	0.40
0.26	0.38
0.24	0.37
0.22	0.35
0.20	0.34

^{a.}U-factor values are determined in accordance with NFRC 100.





^{b.}For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d.Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Project-Out Window with 1" Glazing



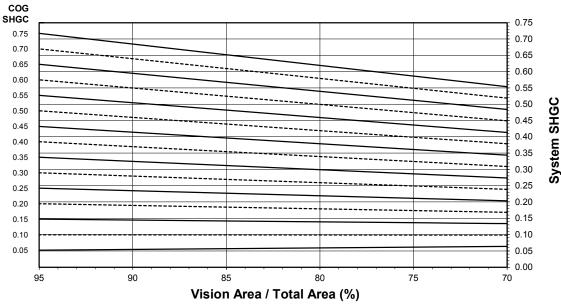

See Note, page 25.

Solar Heat Gain Coefficient (SHGC) Matrix

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.58
0.70	0.55
0.65	0.51
0.60	0.47
0.55	0.43
0.50	0.40
0.45	0.36
0.40	0.32
0.35	0.28
0.30	0.25
0.25	0.21
0.20	0.17
0.15	0.14
0.10	0.10
0.05	0.06

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - AW (Deep) - Project-Out Window with 1" Glazing



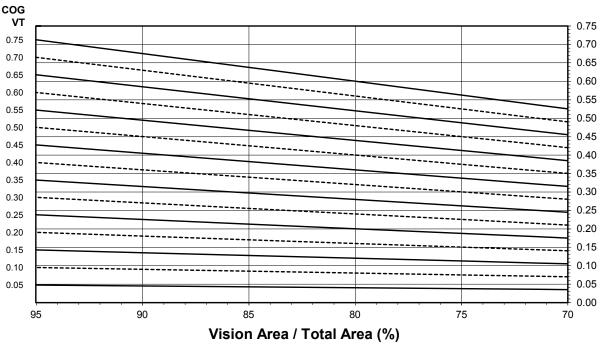

See Note, page 25.

Visible Transmittance (VT)

	\
Glass VT a. b. c.	Overall VT d.
0.75	0.56
0.70	0.52
0.65	0.48
0.60	0.45
0.55	0.41
0.50	0.37
0.45	0.33
0.40	0.30
0.35	0.26
0.30	0.22
0.25	0.19
0.20	0.15
0.15	0.11
0.10	0.07
0.05	0.04

a.VT values are determined in accordance with NFRC 200.

d-Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").



b. For glass values that are not listed, linear interpolation is permitted.

^c·Glass properties are based on center-of-glass values and are obtained from your glass supplier.

AW (Deep) - Project-Out Window with 1-3/4" Glazing (Warm-Edge Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area



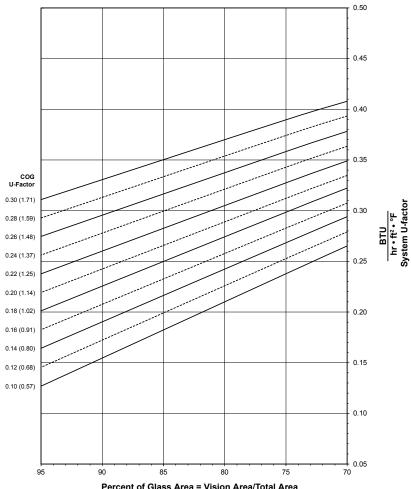

Percent of Glass Area = Vision Area/Total Area Daylight Opening / Projected Area

See Note, page 30.



AW (Deep) - Project-Out Window with 1-3/4" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

		(=:0/: ,
	Glass U-factor a. b. c.	Overall U-factor d.
	0.30	0.39
ĺ	0.28	0.38
	0.26	0.36
	0.24	0.35
	0.22	0.33
ĺ	0.20	0.31
	0.18	0.30
	0.16	0.29
	0.14	0.27
	0.12	0.26
	0.10	0.24

^{a.}U-factor values are determined in accordance with NFRC 100.





^{b.}For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Project-Out Window with 1-3/4" Glazing



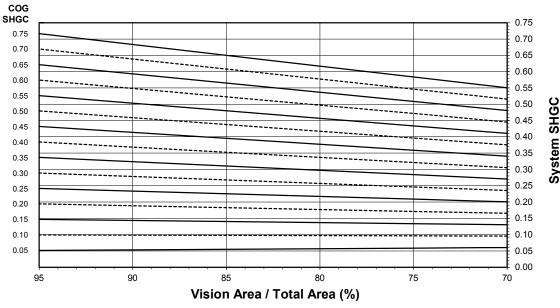

See Note, page 30.

Solar Heat Gain Coefficient (SHGC) Matrix

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.58
0.70	0.54
0.65	0.51
0.60	0.47
0.55	0.43
0.50	0.39
0.45	0.36
0.40	0.32
0.35	0.28
0.30	0.24
0.25	0.21
0.20	0.17
0.15	0.13
0.10	0.10
0.05	0.06

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - AW (Deep) - Project-Out Window with 1-3/4" Glazing



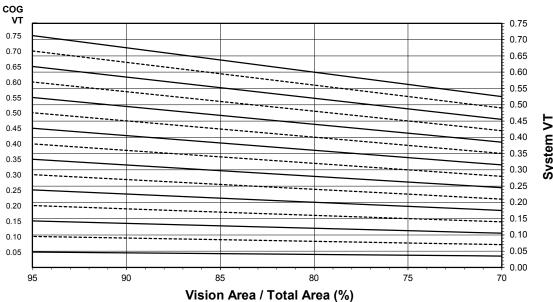

See Note, page 30.

Visible Transmittance (VT)

Violoto Transmittanoo (VI)	
Glass VT a. b. c.	Overall VT d.
0.75	0.56
0.70	0.52
0.65	0.48
0.60	0.45
0.55	0.41
0.50	0.37
0.45	0.33
0.40	0.30
0.35	0.26
0.30	0.22
0.25	0.19
0.20	0.15
0.15	0.11
0.10	0.07
0.05	0.04

a.VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

AW (Deep) - Outswing Casement Window with 1" Glazing (Warm-Edge Glazing Spacer)




NOTE


These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor vs Percent of Glass Area

System U-factor for Glass Area

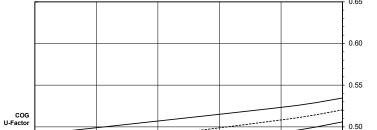

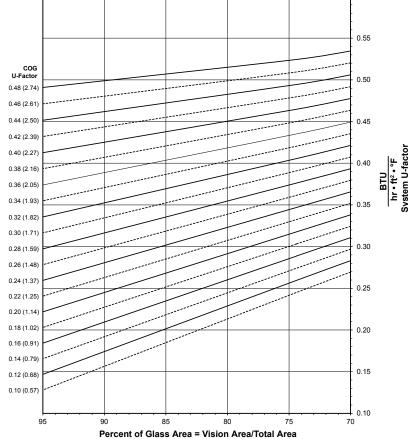

Daylight Opening / Projected Area

See Note, page 34.



AW (Deep) - Outswing Casement Window with 1" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

Thermal Transmittance	
Glass U-factor a. b. c.	Overall U-factor d.
0.48	0.52
0.46	0.51
0.44	0.49
0.42	0.48
0.40	0.46
0.38	0.45
0.36	0.44
0.34	0.42
0.32	0.41
0.30	0.39
0.28	0.38
0.26	0.36
0.24	0.35
0.22	0.33
0.20	0.32
0.18	0.30
0.16	0.29
0.14	0.27
0.12	0.26
0.10	0.24

^{a.}U-factor values are determined in accordance with NFRC 100.




b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d. Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Outswing Casement Window with 1" Glazing



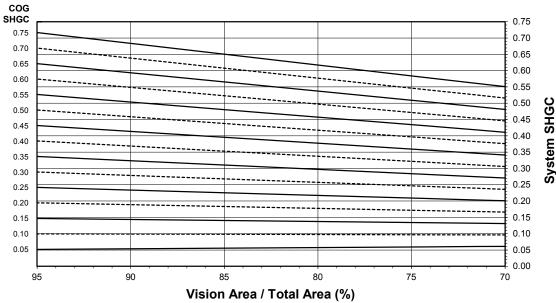

See Note, page 34.

Solar Heat Gain Coefficient (SHGC) Matrix

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.58
0.70	0.54
0.65	0.51
0.60	0.47
0.55	0.43
0.50	0.39
0.45	0.36
0.40	0.32
0.35	0.28
0.30	0.25
0.25	0.21
0.20	0.17
0.15	0.13
0.10	0.10
0.05	0.06

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - AW (Deep) - Outswing Casement Window with 1" Glazing



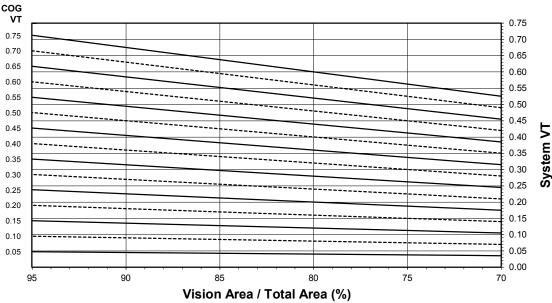

See Note, page 34.

Glass VT a. b. c.	Overall VT d.
0.75	0.56
0.70	0.52
0.65	0.48
0.60	0.45
0.55	0.41
0.50	0.37
0.45	0.33
0.40	0.30
0.35	0.26
0.30	0.22
0.25	0.19
0.20	0.15
0.15	0.11
0.10	0.07
0.05	0.04

a.VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d.Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

AW (Deep) - Outswing Casement Window with 1-3/4" Glazing (Warm-Edge Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area



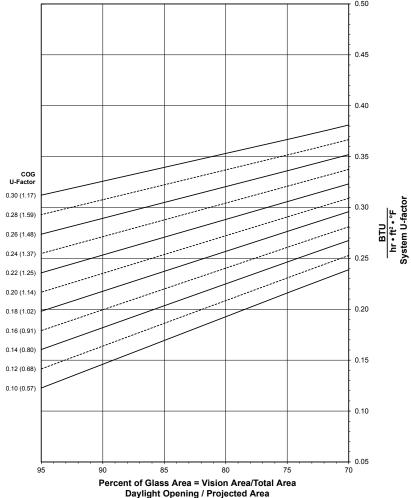

See Note, page 38.



AW (Deep) - Outswing Casement Window with 1-3/4" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

momina manomitano	(515/111 10 1)
Glass U-factor a. b. c.	Overall U-factor d.
0.30	0.37
0.28	0.35
0.26	0.34
0.24	0.32
0.22	0.31
0.20	0.29
0.18	0.28
0.16	0.26
0.14	0.25
0.12	0.23
0.10	0.22
	Glass U-factor a. b. c. 0.30 0.28 0.26 0.24 0.22 0.20 0.18 0.16 0.14 0.12

^{a.}U-factor values are determined in accordance with NFRC 100.





^{b.}For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Outswing Casement Window with 1-3/4" Glazing



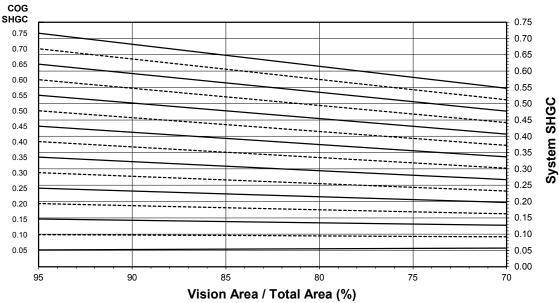

See Note, page 38.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.58
0.70	0.54
0.65	0.50
0.60	0.47
0.55	0.43
0.50	0.39
0.45	0.35
0.40	0.32
0.35	0.28
0.30	0.24
0.25	0.20
0.20	0.17
0.15	0.13
0.10	0.09
0.05	0.06

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - AW (Deep) - Outswing Casement Window with 1-3/4" Glazing



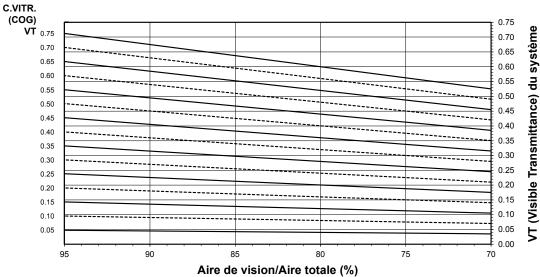

See Note, page 38.

Violoto transmittanes (VI)	
Glass VT a. b. c.	Overall VT d.
0.75	0.56
0.70	0.52
0.65	0.48
0.60	0.45
0.55	0.41
0.50	0.37
0.45	0.33
0.40	0.30
0.35	0.26
0.30	0.22
0.25	0.19
0.20	0.15
0.15	0.11
0.10	0.07
0.05	0.04

^{a.}VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

c.Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

AW (Deep) - Project-Out Window with 1" Glazing (Aluminum Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area

System U-factor vs Percent of Glass Area

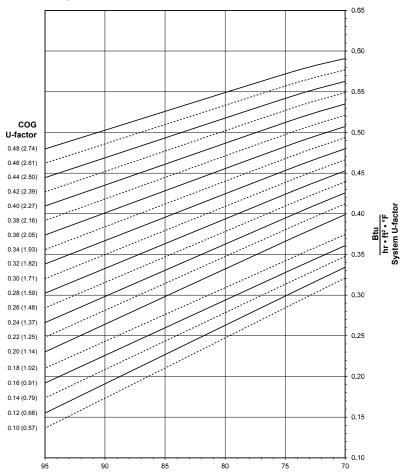

Percent of Glass Area = Vision Area/Total Area Daylight Opening / Projected Area

See Note, page 42.



AW (Deep) - Project-Out Window with 1" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

Thermal Transmittance	
Glass U-factor a. b. c.	Overall U-factor d.
0.48	0.57
0.46	0.56
0.44	0.54
0.42	0.53
0.40	0.52
0.38	0.50
0.36	0.49
0.34	0.47
0.32	0.46
0.30	0.44
0.28	0.43
0.26	0.41
0.24	0.40
0.22	0.38
0.20	0.37

^{a.}U-factor values are determined in accordance with NFRC 100.




^{b.}For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d.Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Project-Out Window with 1" Glazing



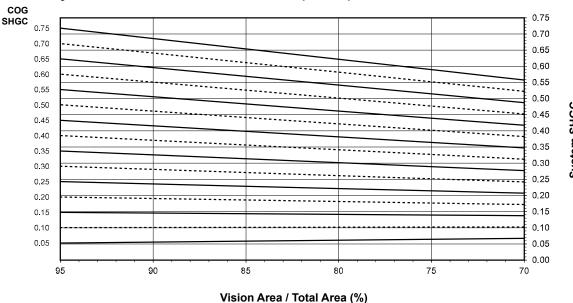

See Note, page 42.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.59
0.70	0.55
0.65	0.51
0.60	0.47
0.55	0.44
0.50	0.40
0.45	0.36
0.40	0.33
0.35	0.29
0.30	0.25
0.25	0.21
0.20	0.18
0.15	0.14
0.10	0.10
0.05	0.06

^{a.}SHGC values are determined in accordance with NFRC 200.




b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - AW (Deep) - Project-Out Window with 1" Glazing

System Visible Transmittance (VT) vs Percent of Vision Area

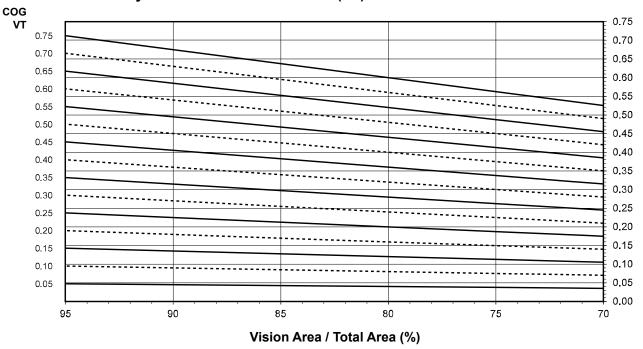

See Note, page 42.

	\
Glass VT a. b. c.	Overall VT d.
0.75	0.56
0.70	0.52
0.65	0.48
0.60	0.45
0.55	0.41
0.50	0.37
0.45	0.33
0.40	0.30
0.35	0.26
0.30	0.22
0.25	0.19
0.20	0.15
0.15	0.11
0.10	0.07
0.05	0.04

a.VT values are determined in accordance with NFRC 200.

d-Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").



b. For glass values that are not listed, linear interpolation is permitted.

^c·Glass properties are based on center-of-glass values and are obtained from your glass supplier.

AW (Deep) - Project-Out Window with 1-3/4" Glazing (Aluminum Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area



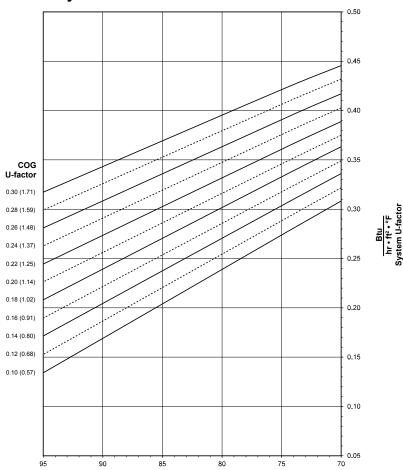

Percent of Glass Area = Vision Area/Total Area
Daylight Opening / Projected Area

See Note, page 46.



AW (Deep) - Project-Out Window with 1-3/4" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

	· · · · · · · · · · · · · · · · · · ·
Glass U-factor a. b. c.	Overall U-factor d.
0.30	0.42
0.28	0.41
0.26	0.39
0.24	0.38
0.22	0.36
0.20	0.35
0.18	0.34
0.16	0.32
0.14	0.31
0.12	0.29
0.10	0.28

^{a.}U-factor values are determined in accordance with NFRC 100.





^{b.}For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Project-Out Window with 1-3/4" Glazing



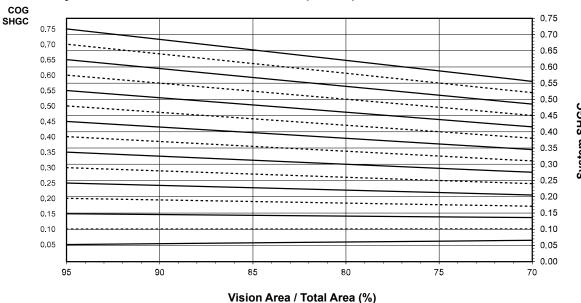

See Note, page 46.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.58
0.70	0.55
0.65	0.51
0.60	0.47
0.55	0.44
0.50	0.40
0.45	0.36
0.40	0.32
0.35	0.29
0.30	0.25
0.25	0.21
0.20	0.17
0.15	0.14
0.10	0.10
0.05	0.06

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - AW (Deep) - Project-Out Window with 1-3/4" Glazing



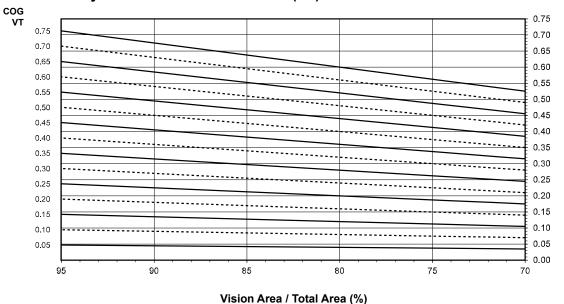

See Note, page 46.

Overall VT d.
0.56
0.52
0.48
0.45
0.41
0.37
0.33
0.30
0.26
0.22
0.19
0.15
0.11
0.07
0.04

a.VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

AW (Deep) - Outswing Casement Window with 1" Glazing (Aluminum Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area



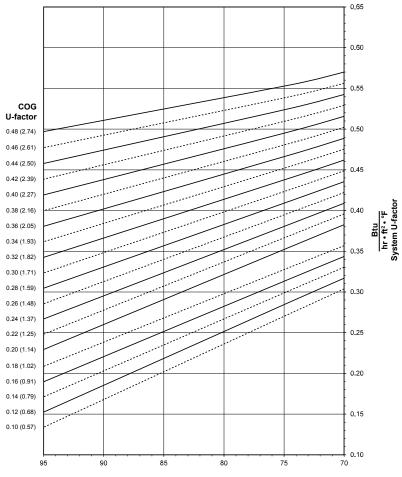

Percent of Glass Area = Vision Area/Total Area Daylight Opening / Projected Area

See Note, page 50.



AW (Deep) - Outswing Casement Window with 1" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

Thermal Transmittance	
Glass U-factor a. b. c.	Overall U-factor d.
0.48	0.55
0.46	0.54
0.44	0.53
0.42	0.51
0.40	0.50
0.38	0.48
0.36	0.47
0.34	0.45
0.32	0.44
0.30	0.43
0.28	0.41
0.26	0.40
0.24	0.38
0.22	0.37
0.20	0.36
0.18	0.33
0.16	0.32
0.14	0.30
0.12	0.29
0.10	0.27
3116 ()	1. 1 20 81

^{a.}U-factor values are determined in accordance with NFRC 100.




b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d. Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Outswing Casement Window with 1" Glazing

System Solar Heat Gain Coefficient (SHGC) vs Percent of Vision Area

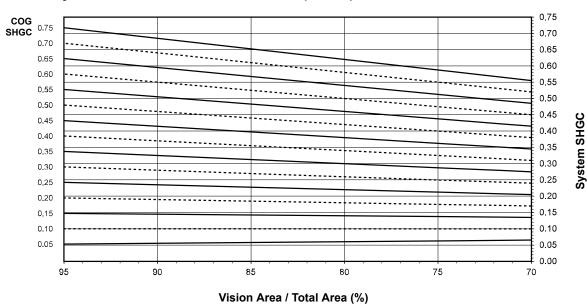

See Note, page 50.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.58
0.70	0.55
0.65	0.51
0.60	0.47
0.55	0.43
0.50	0.40
0.45	0.36
0.40	0.32
0.35	0.29
0.30	0.25
0.25	0.21
0.20	0.17
0.15	0.14
0.10	0.10
0.05	0.06

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - AW (Deep) - Outswing Casement Window with 1" Glazing



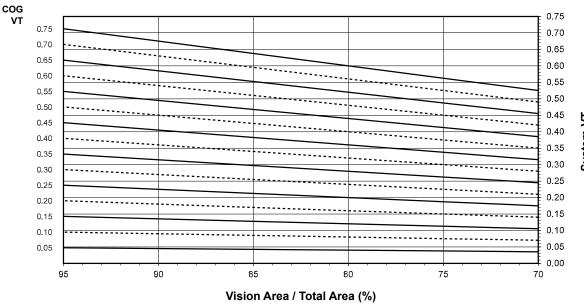

See Note, page 50.

Glass VT a. b. c.	Overall VT d.
0.75	0.56
0.70	0.52
0.65	0.48
0.60	0.45
0.55	0.41
0.50	0.37
0.45	0.33
0.40	0.30
0.35	0.26
0.30	0.22
0.25	0.19
0.20	0.15
0.15	0.11
0.10	0.07
0.05	0.04

a.VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

AW (Deep) - Outswing Casement Window with 1-3/4" Glazing (Aluminum Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area



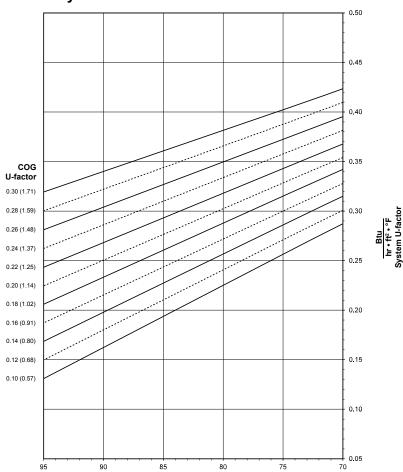

Percent of Glass Area = Vision Area/Total Area
Daylight Opening / Projected Area

See Note, page 54.



AW (Deep) - Outswing Casement Window with 1-3/4" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

	(=:0/: :. : /
Glass U-factor a. b. c.	Overall U-factor d.
0.30	0.40
0.28	0.39
0.26	0.38
0.24	0.36
0.22	0.35
0.20	0.33
0.18	0.32
0.16	0.30
0.14	0.29
0.12	0.27
0.10	0.26

^{a.}U-factor values are determined in accordance with NFRC 100.




^{b.}For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - AW (Deep) - Outswing Casement Window with 1-3/4" Glazing



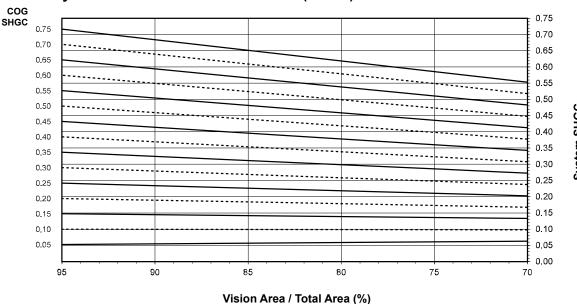

See Note, page 54.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.58
0.70	0.54
0.65	0.51
0.60	0.47
0.55	0.43
0.50	0.40
0.45	0.36
0.40	0.32
0.35	0.28
0.30	0.25
0.25	0.21
0.20	0.17
0.15	0.14
0.10	0.10
0.05	0.06

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - AW (Deep) - Outswing Casement Window with 1-3/4" Glazing



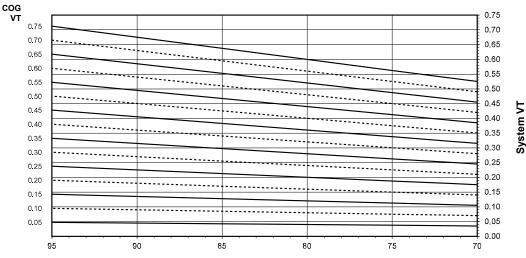

Vision Area / Total Area (%)

See Note, page 54.

Violbio Transmittanios (VI)		
Glass VT a. b. c.	Overall VT d.	
0.75	0.56	
0.70	0.52	
0.65	0.48	
0.60	0.45	
0.55	0.41	
0.50	0.37	
0.45	0.33	
0.40	0.30	
0.35	0.26	
0.30	0.22	
0.25	0.19	
0.20	0.15	
0.15	0.11	
0.10	0.07	
0.05	0.04	

^{a.}VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

c.Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

CW (Shallow) - Project-Out Window with 1" Glazing (Aluminum Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area



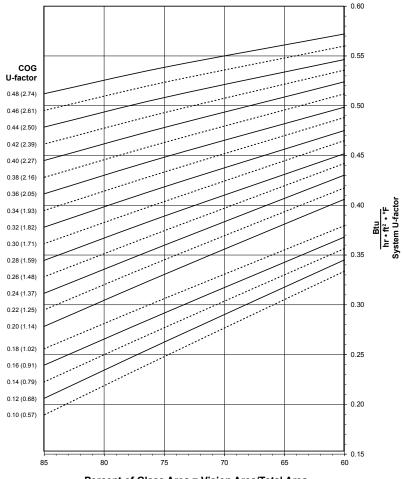

Percent of Glass Area = Vision Area/Total Area
Daylight Opening / Projected Area

See Note, page 58.



CW (Shallow) - Project-Out Window with 1" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

•	nermai mansimitance	(BIO/III · It · I)
	Glass U-factor a. b. c.	Overall U-factor d.
	0.48	0.54
	0.46	0.52
	0.44	0.51
	0.42	0.49
	0.40	0.48
	0.38	0.46
	0.36	0.45
	0.34	0.43
	0.32	0.42
	0.30	0.40
	0.28	0.39
	0.26	0.38
	0.24	036
	0.22	0.35
	0.20	0.33
	0.18	0.31
	0.16	0.29
	0.14	0.28
	0.12	0.26
	0.10	0.25
_		

^{a.}U-factor values are determined in accordance with NFRC 100.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d. Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - CW (Shallow) - Project-Out Window with 1" Glazing



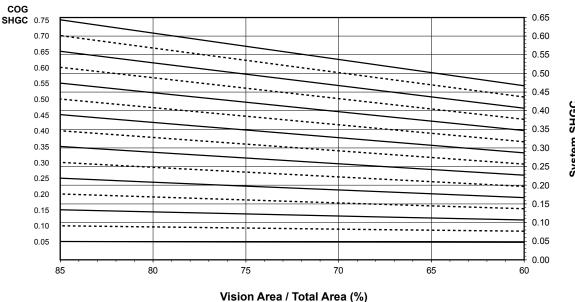

See Note, page 58.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.57
0.70	0.53
0.65	0.50
0.60	0.46
0.55	0.42
0.50	0.38
0.45	0.35
0.40	0.31
0.35	0.27
0.30	0.23
0.25	0.20
0.20	0.16
0.15	0.12
0.10	0.09
0.05	0.05

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - CW (Shallow) - Project-Out Window with 1" Glazing



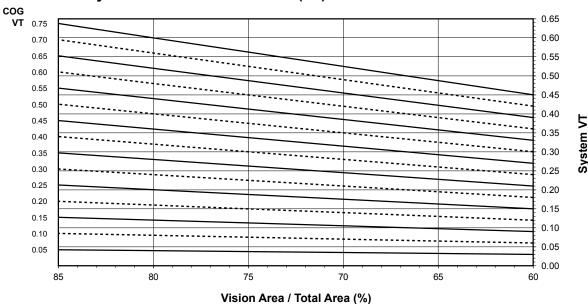

See Note, page 58.

VIOIDIO TIUTIOTITICUTIOO (VI)		
Glass VT a. b. c.	Overall VT d.	
0.75	0.56	
0.70	0.52	
0.65	0.49	
0.60	0.45	
0.55	0.41	
0.50	0.37	
0.45	0.34	
0.40	0.30	
0.35	0.26	
0.30	0.22	
0.25	0.19	
0.20	0.15	
0.15	0.11	
0.10	0.07	
0.05	0.04	

a.VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

CW (Shallow) - Project-Out Window with 1-3/4" Glazing (Aluminum Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area

System U-factor vs Percent of Glass Area

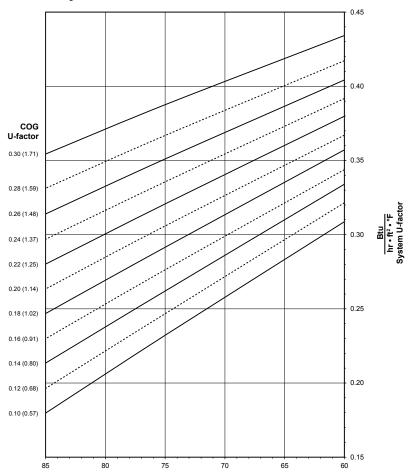

Percent of Glass Area = Vision Area/Total Area Daylight Opening / Projected Area

See Note, page 62.



CW (Shallow) - Project-Out Window with 1-3/4" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

Thermal Transmittance	
Glass U-factor a. b. c.	Overall U-factor d.
0.31	0.39
0.28	0.37
0.26	0.35
0.24	0.34
0.22	0.32
0.20	0.31
0.18	0.29
0.16	0.28
0.14	0.26
0.12	0.25
0.10	0.23

^{a.}U-factor values are determined in accordance with NFRC 100.





^{b.}For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - CW (Shallow) - Project-Out Window with 1-3/4" Glazing



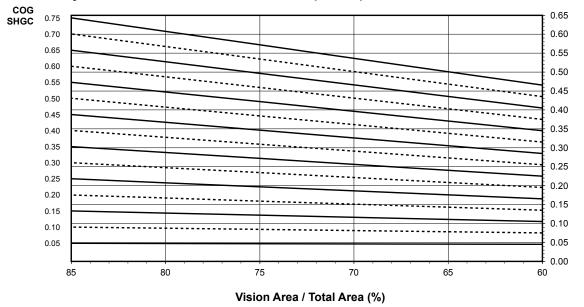

See Note, page 62.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.57
0.70	0.53
0.65	0.50
0.60	0.46
0.55	0.42
0.50	0.38
0.45	0.35
0.40	0.31
0.35	0.27
0.30	0.23
0.25	0.20
0.20	0.16
0.15	0.12
0.10	0.08
0.05	0.05

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - CW (Shallow) - Project-Out Window with 1-3/4" Glazing



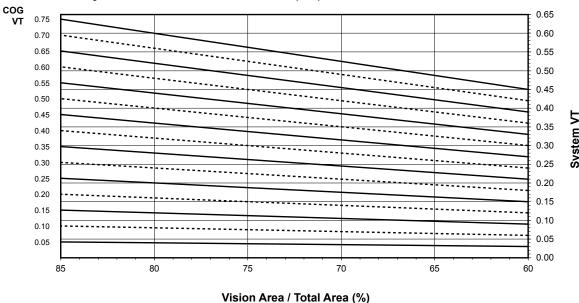

See Note, page 62.

visible mansimuance (vi)		
Glass VT a. b. c.	Overall VT d.	
0.75	0.56	
0.70	0.52	
0.65	0.49	
0.60	0.45	
0.55	0.41	
0.50	0.37	
0.45	0.34	
0.40	0.30	
0.35	0.26	
0.30	0.22	
0.25	0.19	
0.20	0.15	
0.15	0.11	
0.10	0.07	
0.05	0.04	

a.VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

CW (Shallow) - Outswing Casement Window with 1" Glazing (Aluminum Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area



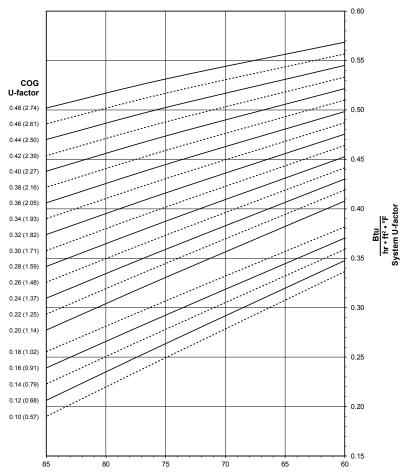

Percent of Glass Area = Vision Area/Total Area Daylight Opening / Projected Area

See Note, page 66.



CW (Shallow) - Outswing Casement Window with 1" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

٠	nemai mansimitance	(BIO/III · It · I)
	Glass U-factor a. b. c.	Overall U-factor d.
	0.48	0.53
	0.46	0.52
	0.44	0.50
	0.42	0.49
	0.40	0.47
	0.38	0.46
	0.36	0.45
	0.34	0.43
	0.32	0.42
	0.30	0.40
	0.28	0.39
	0.26	0.37
	0.24	0.36
	0.22	0.35
	0.20	0.33
	0.18	0.31
	0.16	0.29
	0.14	0.28
	0.12	0.27
	0.10	0.25
-		

^{a.}U-factor values are determined in accordance with NFRC 100.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d. Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - CW (Shallow) - Outswing Casement Window with 1" Glazing



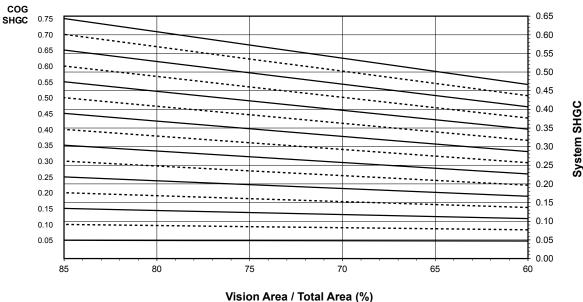

See Note, page 66.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.57
0.70	0.53
0.65	0.50
0.60	0.46
0.55	0.42
0.50	0.38
0.45	0.35
0.40	0.31
0.35	0.27
0.30	0.23
0.25	0.20
0.20	0.16
0.15	0.12
0.10	0.09
0.05	0.05

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - CW (Shallow) - Outswing Casement Window with 1" Glazing



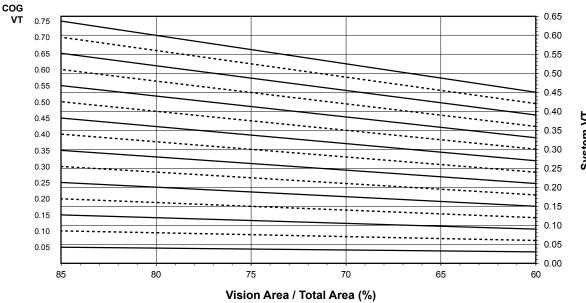

See Note, page 66.

Glass VT a. b. c.	Overall VT d.
0.75	0.56
0.70	0.52
0.65	0.49
0.60	0.45
0.55	0.41
0.50	0.37
0.45	0.34
0.40	0.30
0.35	0.26
0.30	0.22
0.25	0.19
0.20	0.15
0.15	0.11
0.10	0.07
0.05	0.04

a.VT values are determined in accordance with NFRC 200.



^{b.}For glass values that are not listed, linear interpolation is permitted.

c.Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

CW (Shallow) - Outswing Casement Window with 1-3/4" Glazing (Aluminum Glazing Spacer)




NOTE

These notes apply to the charts for system U-factor, solar heat gain coefficient (SHGC), and visible transmittance (VT):

- · Values in parentheses are metric.
- · COG = Center of Glass
- · Charts are generated per AAMA 507.
- For glass values that are not listed, linear interpolation is permitted.
- Glass properties are based on center-of-glass values and are obtained from your glass supplier.

System U-factor for Glass Area



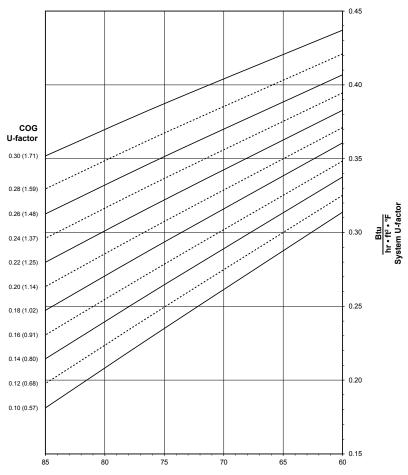

Percent of Glass Area = Vision Area/Total Area
Daylight Opening / Projected Area

See Note, page 70.



CW (Shallow) - Outswing Casement Window with 1-3/4" Glazing

Thermal Transmittance (BTU/hr • ft² • °F)

	manomittanoo	(510/111 10 1)
Glass U	-factor a.b. c.	Overall U-factor d.
0.31		0.39
0.28		0.37
0.26		0.35
0.24		0.34
0.22		0.32
0.20		0.31
0.18		0.29
0.16		0.28
0.14		0.27
0.12		0.25
0.10		0.24

^{a.}U-factor values are determined in accordance with NFRC 100.




^{b.}For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

^d·Overall U-factor values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Solar Heat Gain Coefficient (SHGC) - CW (Shallow) - Outswing Casement Window with 1-3/4" Glazing



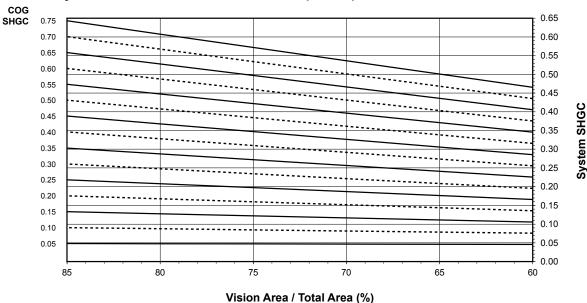

See Note, page 70.

Glass SHGC a. b. c.	Overall SHGC d.
0.75	0.57
0.70	0.53
0.65	0.50
0.60	0.46
0.55	0.42
0.50	0.38
0.45	0.35
0.40	0.31
0.35	0.27
0.30	0.23
0.25	0.20
0.20	0.16
0.15	0.12
0.10	0.08
0.05	0.05

^{a.}SHGC values are determined in accordance with NFRC 200.





b. For glass values that are not listed, linear interpolation is permitted.

^{c.}Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d-Overall SHGC values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

System Visible Transmittance (VT) - CW (Shallow) - Outswing Casement Window with 1-3/4" Glazing



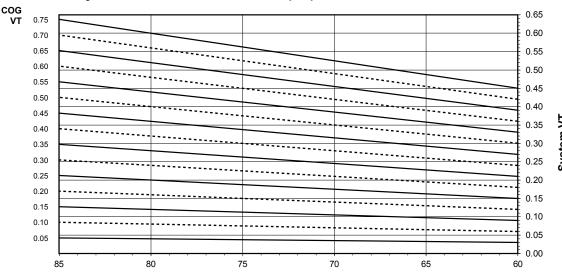

Vision Area / Total Area (%)

See Note, page 70.

Glass VT a. b. c.	Overall VT d.
0.75	0.56
0.70	0.52
0.65	0.49
0.60	0.45
0.55	0.41
0.50	0.37
0.45	0.34
0.40	0.30
0.35	0.26
0.30	0.22
0.25	0.19
0.20	0.15
0.15	0.11
0.10	0.07
0.05	0.04

a.VT values are determined in accordance with NFRC 200.



b. For glass values that are not listed, linear interpolation is permitted.

^c·Glass properties are based on center-of-glass values and are obtained from your glass supplier.

d.Overall VT values are based on the standard NFRC specimen size of 1,500 mm wide by 600 mm high (59-1/6" by 23-5/8").

Notes And Disclaimers

Laws and building and safety codes governing the design and use of Kawneer products, such as glazed entrance, window, and curtain wall products, vary widely. Kawneer does not control the selection of product configurations, operating hardware, or glazing materials, and assumes no responsibility therefor. It is the responsibility of the owner, the specifier, the architect, the general contractor, and the installer and the fabricator/transformer, consistent with their roles, to determine the appropriate materials for a project in strict conformity to all applicable national, regional and local building codes and regulations.

Kawneer reserves the right to change configuration without prior notice when deemed necessary for product improvement.

Information contained herein or related hereto is intended only for evaluation by technically skilled persons, with any use thereof to be at their independent discretion and risk. Such information is believed to be reliable, but Kawneer shall have no responsibility or liability for results obtained or damages resulting from such use.

Kawneer grants no license under, and shall have no responsibility or liability for infringement of, any patent or other proprietary right. Nothing in this document should be construed as a warranty or guarantee by Kawneer, and the only applicable warranties will be those set forth in Kawneer acknowledgment or in any printed warranty documents issued by Kawneer. The foregoing may be waived or modified only in writing by a Kawneer officer.

© 2020, Kawneer Company, Inc.

